




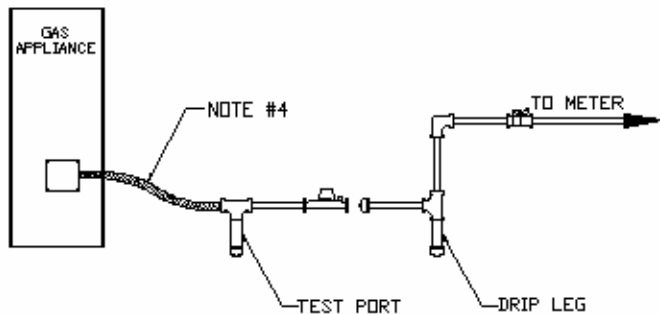

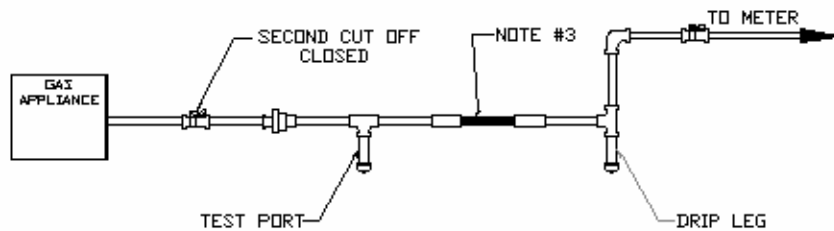

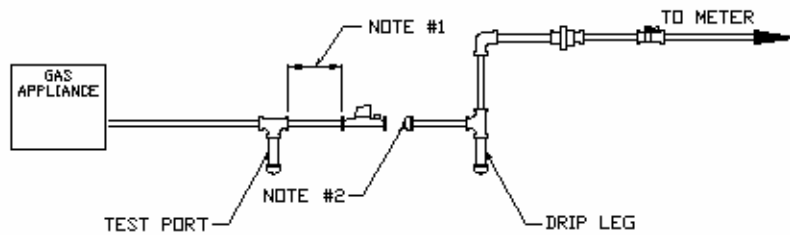




EXAMPLE TESTING PROCEDURES FOR & 2 & 5 LB. SYSTEMS (SEE BACK FOR STANDARD SYSTEM)

“NOTES”


- (1) DOWN STREAM TEST PORT **MUST BE** WITHIN TEN (10) PIPE DIAMETERS OF THE REGULATOR.
SECTION 410.2 (IFGC)
- (2) MAY USE A SECOND CUT-OFF IN LIEU OF CAPPING OFF PIPE.
- (3) IF A TEMPORARY BLANK IS USED, TAPE OR TIE REGULATOR TO THE TEMPORARY BLANK FOR INSPECTION.
- (4) IF A FLEXABLE CONNECTOR IS USED, MAKE SURE IT DOES NOT PENETRATE THE HOUSING UNLESS IT HAS BEEN APPROVED FOR THAT SPECIFIC APPLICATION
SECTION 411 (IFGC)




SYMBOL LIBRARY

	= CAP
	= COUPLING
	= CUT OFF
	= DRIP LEG
	= 90° ELL
	= REGULATOR
	= TEE
	= TEST PORT
	= UNION

**APPROVED TESTING PROCEDURE
FOR STANDARD GAS PIPING SYSTEM
WITHOUT REGULATOR**

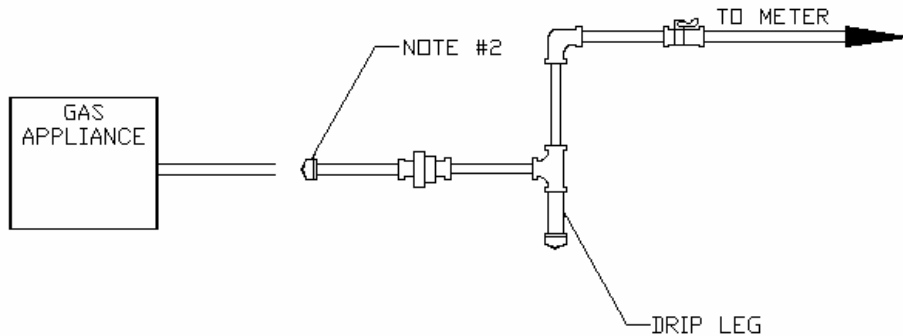

**APPROVED TESTING
PROCEDURES FOR STANDARD
&
(2 & 5 POUND) GAS PIPING
SYSTEMS**

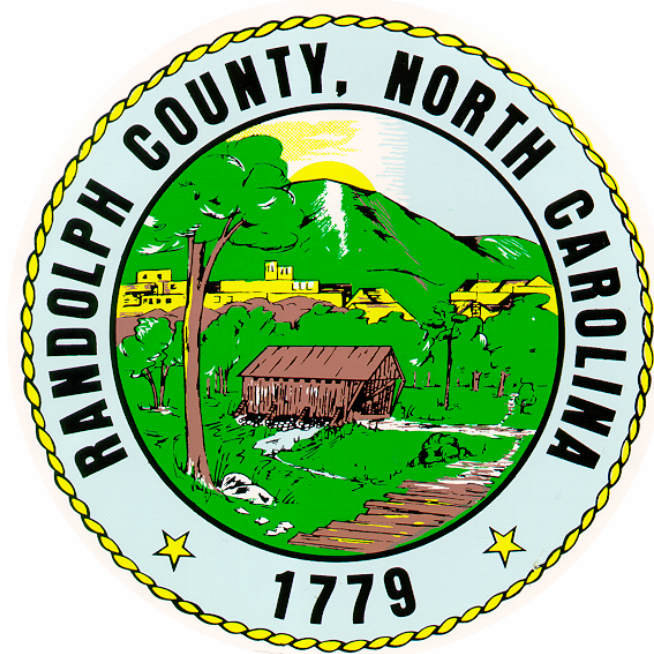

BUILDING INSPECTIONS CONTACT NUMBERS:

ASHEBORO OFFICE

BRIAN HEILIG, MECHANICAL: 336-318-6363

DANNY YORK, MECHANICAL: 336-318-6563

ARCHDALE OFFICE

DANNY KEYE, MECHANICAL: 336-318-6580

**RANDOLPH COUNTY
DEPARTMENT OF BUILDING INSPECTIONS
204 East Academy St
Asheboro, NC 27203
336-318-6565**